



All rights reserved. This drawing or any part thereof must not be reproduced in any form without the written permission of Aero-Power Utilized Fueler, Inc.


2" TANK SUPPORT
EXTENSION FOR ANCHORING
(3/4" HOLE) - 4 TYP

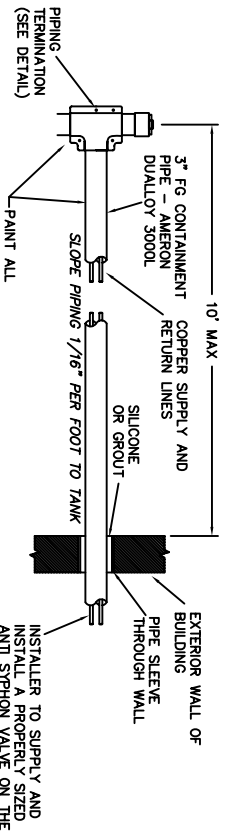

PIPING DETAIL
SCALE: NONE

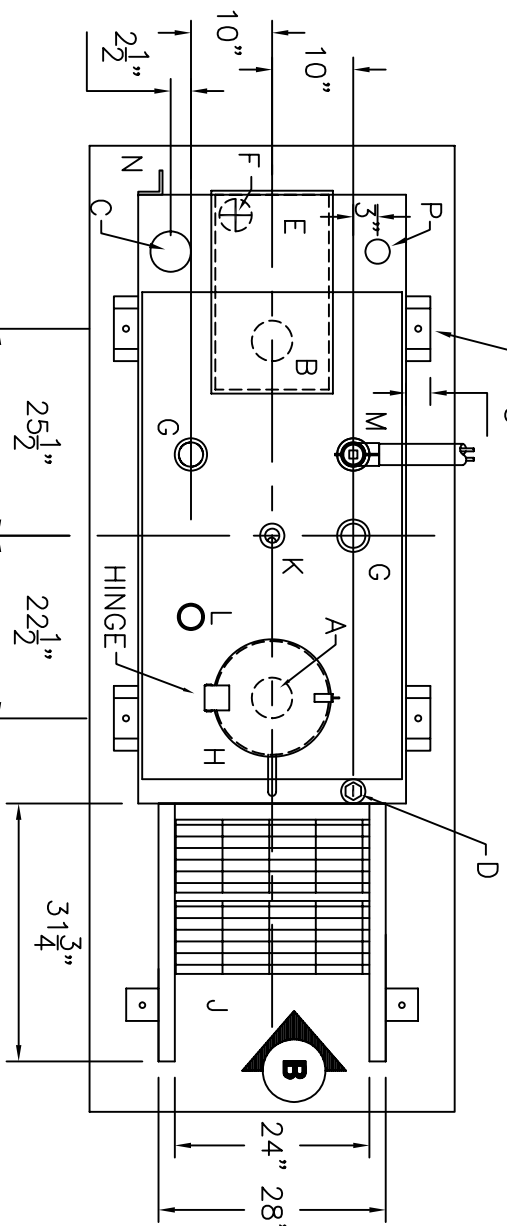

PLAN VIEW

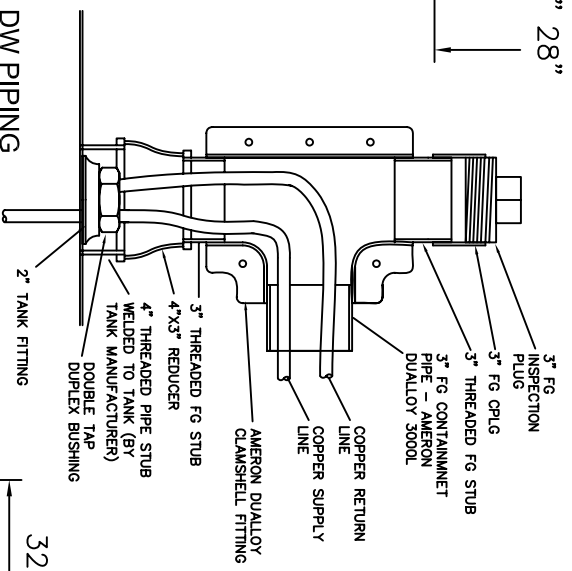

TERMINATION DETAIL
SCALE: NONE

SCDHS APPROVAL STAMP

LEGEND

- A 4" FILL FITTING WITH 2" INTERNAL OVERFILL PREVENTION VALVE*, QUICK CONNECT, AND DUST CAP
* MORRISON MODEL #9095A
ADD LABEL TO OVERFILL CONTAINER LID STATING: "WARNING: TIGHT FIT ONLY! THE FIT DEVICE WILL NOT ACCEPT A LOOSE FIT. THE FIT WILL PREVENT OVERFILLING, SPLASH AND SPILLAGE." PAINT FOR API COLOR CODES-GREEN HEXAGON FOR FUEL OIL.
- B 4" FITTING - 4" MALE THRD EMERGENCY VENT EMERGENCY VENT
OPW MODEL #202
- C 4" FITTING MOUNTED IN INTERSTICE - MARK W/ SPECIAL LABEL - SECONDARY EMERGENCY VENT EMERGENCY VENT - 119,750 CFH REQUIRED MORRISON MODEL # 244M
- D 2" FITTING - INTERSTITIAL MONITOR CONNECTION, 2" NPT BUSHING WITH KREUGER K-2-60 LEAK GAUGE
- E EMERGENCY VENT DEFLECTOR WITH SLIP-ON LID - BODY SIZE - 14" WIDE X 24" LONG X 11" HIGH
LID IS SLIP FIT TO ALLOW PRESSURE TO VENT
- F 6" MALE NPT WITH 4" PROJECTION WITH 2 CROSS BARS - MOUNTED IN OUTER SHELL AT TOP - CHAMBER OVERFLOW TO INTERSTICE WITH CROSSBAR
- G 2" FITTING WITH 4"Ø X 2" HIGH PIPE STUB WELDED AROUND FITTING
- H 8 GALLON WELDED OVERFILL WITH 1" OVERFLOW PIPE C/W API GREEN HEXAGON BOLT TO TANK STYLE STEPS AND HANDRAIL
- J 2" FITTING - WITH 2" KREUGER GAUGE
- K 2" FITTING WITH 2" VENT WHISTLE AND OPW 2" ALUMINUM NORMAL VENT CAP AND EXTENSION PIPE
- L DOUBLE WALL PIPING TERMINATION ASSEMBLY PER DETAIL
- M L3 X 3 X 3/8" THICK GROUNDING LUG WITH 3/8"Ø HOLE ON CL OF PROJECTING LEG
- P 2" FITTING WITH 10" HIGH PIPE AND 2" OPW ALUMINUM NORMAL VENT CAP

GENERAL NOTES

THE APPROVAL OF PLANS AND ISSUANCE OF PERMIT TO CONSTRUCT HAZARDOUS MATERIALS STORAGE FACILITY PROPOSES COMPLIANCE WITH ARTICLE 12 OF THE SUFFOLK COUNTY SANITARY CODE ONLY. IT IS THE OWNERS AND/OR HIS AGENTS RESPONSIBILITY TO ENSURE THAT ALL OTHER APPLICABLE CODES AND REGULATIONS WILL BE MET PRIOR TO, DURING AND AFTER INSTALLATION
THE STORAGE FACILITY INSTALLING CONTRACTOR IS STRICTLY PROHIBITED FROM SUBSTITUTING EQUIPMENT LISTED IN THE DRAWINGS
CONTAINMENT VOLUME REQUIRED =
500 X 110% = 550 GALLONS
CONTAINMENT PROVIDED =
(75" L X 60.5" H X 32.5" W) / 231 = 638 GALLONS
THE SYSTEM MUST BE INSTALLED IN STRICT ACCORDANCE WITH ALL APPLICABLE REGULATIONS INCLUDING, BUT NOT LIMITED TO, THE NEW YORK STATE UNIFORM FIRE PREVENTION AND BUILDING CODE, ARTICLE 12 OF THE SUFFOLK COUNTY SANITARY CODE, AND ALL LOCAL BUILDING AND PLUMBING DEPARTMENT ORDINANCES
ALL WORK IS TO BE IN STRICT ACCORDANCE WITH APPLICABLE NATIONAL FIRE PREVENTION ASSOCIATION RECOMMENDATIONS. GROUNDING OF THE CONTAINMENT UNIT AND /OR ITS CONTENTS MAY BE REQUIRED
ALL WORK IS TO BE IN STRICT CONFORMANCE WITH APPLICABLE NATIONAL ELECTRICAL CODE SPECIFICATIONS AND REQUIREMENTS
THE FACILITY OWNER SHALL BE RESPONSIBLE FOR ENSURING THAT ALL REQUIRED PERMITS FOR INSTALLATION OF THE UNIT HAVE BEEN SECURED
STORAGE UNITS LOCATED IN TRAFFIC AREAS MUST BE PROTECTED BY TRAFFIC BOLLARDS. THE BOLLARDS MUST BE MADE OF SCHEDULE 80 PIPE, CONCRETE FILLED, AND SET IN THE GROUND TO A DEPTH OF 4 FEET. THE BOLLARDS WILL BE SET IN CONCRETE FOOTINGS. THE BOLLARDS SHALL BE A MINIMUM OF 4 FEET ABOVE GRADE. BOLLARDS SHALL BE SPACED NO MORE THAN 4 FEET APART. THE DIAMETER OF THE STEEL PIPE SHALL DEPEND ON THE TYPE OF TRAFFIC LIKELY TO BE PRESENT.
STORAGE UNITS LOCATED IN FLOOD PLANS MUST BE SECURED TO THE GROUND. THE TANK HAS TO BE SECURED TO THE SECONDARY CONTAINMENT.
ALL PIPING INSTALLED ON THIS UNIT MUST BE PAINTED TO PREVENT UV DEGRADATION OF THE PIPING

SPECIFICATIONS


| |
|--|
| CAPACITY - 500 GALLONS |
| TANK MATERIAL - MILD CARBON STEEL |
| THICKNESS - INNER - 12 GAUGE |
| THICKNESS - OUTER - 12 GAUGE |
| CONSTRUCTION - ALL - LAP WELD OUTSIDE ONLY |
| TANK TEST - 2 PSIG |
| INT. FINISH - NONE |
| EXT. FINISH - SP6, EPOXY PRIMER, EPOXY INTERMEDIATE COAT, AND (2) COATS WHITE URETHANE PAINT |
| LABEL - UL 142 DOUBLE WALL OUTER TANK IS 110% CONTAINMENT |

ADD COLOR CODING NOTES: CROSS BARS @ 8/9/07 -
OVERFLOW PORT; MONITORING STICK @
INTERSTITIAL PORT; RE-ARRANGE SHEET.


AERO-POWER ®
PATENT NUMBER 5346093

500 GAL DW RECTANGULAR TANK

CUSTOMER: -
PROJECT: #2 FUEL OIL
QUOTE: -
SCALE 1/2" = 12"
DATE 7/1/04
DRAWN BY 001
DRAWING NUMBER 500FUELOIL

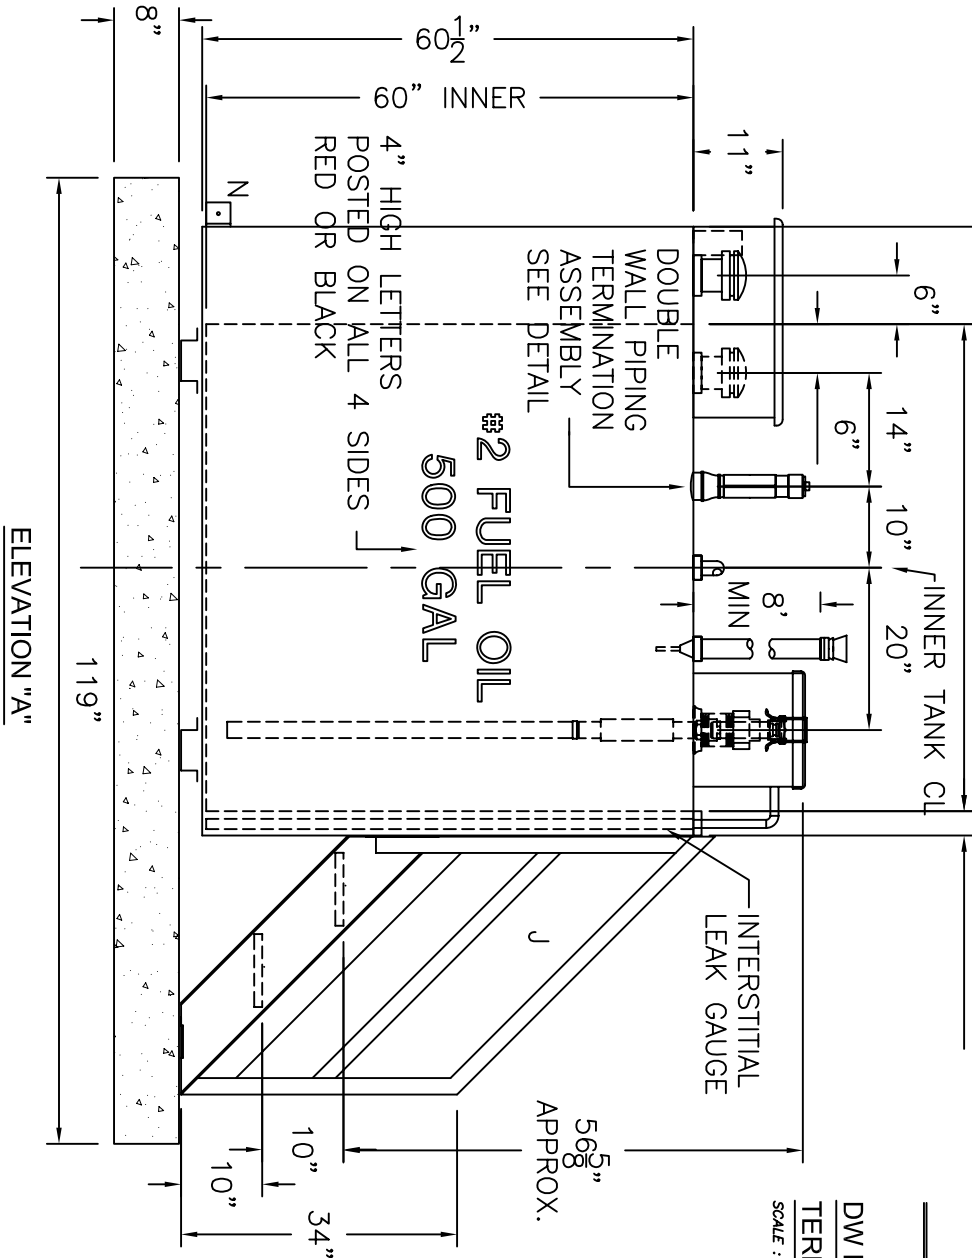

ELEVATION "A"

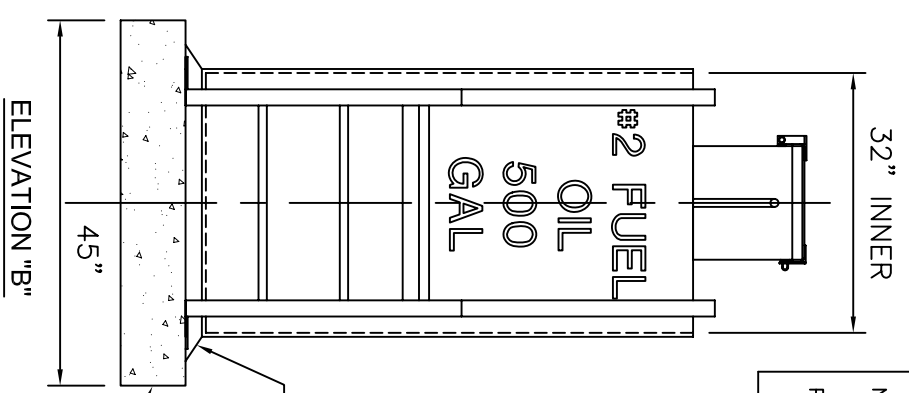

ELEVATION "B"